



3-PHASE INFEED TERMINAL, FOR 3-PHASE
BUSBAR, SZ S0 UND S00, CONNECTION FROM
BELOW

General technical data:

product brand name		SIRIUS
Product designation		Three-phase feeder terminal
Design of the product		Size S0/S00
Size of the circuit-breaker		S00, S0
Protection class IP on the front		IP20
Insulation voltage with degree of pollution 3 Rated value	V	690
Ambient temperature		
• during storage	°C	-50 ... +80
• during operation	°C	-20 ... +60
Ampacity maximum	A	63

Installation/ mounting/ dimensions:

Width	mm	42.8
Height	mm	73.5
Depth	mm	48

Connections/ Terminals:

Type of electrical connection for main current circuit		screw-type terminals
Type of connectable conductor cross-section		
• for main contacts		
— solid		1x (2.5 ... 16 mm ²)
— stranded		1x (2.5 ... 25 mm ²)
— finely stranded		
— with core end processing		1x (2.5 ... 16 mm ²)
• for AWG conductors for main contacts		1x (10 ... 4)

Certificates/ approvals:

Certificate of suitability		CE / UL / CSA / CCC
----------------------------	--	---------------------

General Product Approval		Declaration of Conformity	Test Certificates		Shipping Approval
			Type Test Certificates/Test Report	Special Test Certificate	
CSA	UL	EG-Konf.			ABS

Shipping Approval					
					
BUREAU VERITAS	DNV	GL	LRS	PRS	RINA

Shipping Approval	other				
	Environmental Confirmations	Confirmation		other	
RMRS			VDE		

Further information

Information- and Downloadcenter (Catalogs, Brochures,...)

<http://www.siemens.com/industrial-controls/catalogs>

Industry Mall (Online ordering system)

<http://www.siemens.com/industrymall>

Cax online generator


<http://support.automation.siemens.com/WW/CAXorder/default.aspx?lang=en&mlfb=3RV29155B>

Service&Support (Manuals, Certificates, Characteristics, FAQs,...)


<https://support.industry.siemens.com/cs/ww/en/ps/3RV29155B>

Image database (product images, 2D dimension drawings, 3D models, device circuit diagrams, EPLAN macros, ...)

http://www.automation.siemens.com/bilddb/cax_de.aspx?mlfb=3RV29155B&lang=en

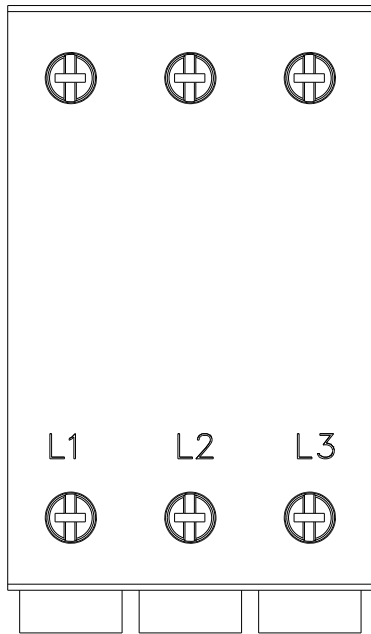

last modified:

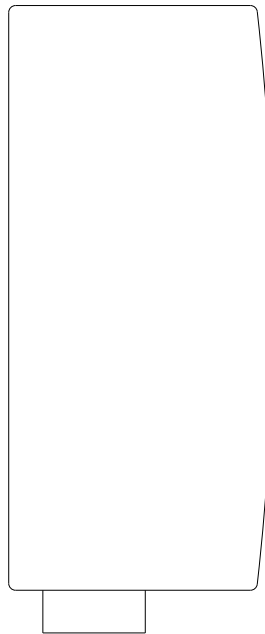

20.04.2015